

WILDER RURAL FIRE PROTECTION DISTRICT

601 Patriot Way - P.O. Box 222

Wilder, Idaho 83676

Phone: 208-482-7563 / Fax: 208-482-6338

BUILDING/DRIVEWAY PERMIT APPLICATION

Information to Applicant:

1. The Applicant must complete this form and pay the filing fee before the Fire District will process this form. The Inspection Officer of the Fire District will determine the appropriate fee per the Wilder Fire District Inspection Fee Schedule.
2. All relevant information and attachments must be supplied. Please mark non-applicable portions of the application form "N.A." The Fire Chief of the Fire District shall determine the completeness of this application. This form must be completed and received by the Fire Chief and/or the Fire District's Secretary/Treasurer.
3. All applications are filed with the Secretary of the Fire District at the administrative office located at 601 Patriot Way, Wilder, Idaho 83676. (Mailing address P.O. Box 222, Wilder, Idaho 83676.)
4. Applicant must be 18 years of age.

Application Date: _____

Name of Applicant(s): _____

Applicant's Address: _____

Primary Phone Number: _____ Secondary (or Cell) Phone Number: _____

Relationship: Owner ___ Builder ___ Other: _____

Project location (or address): _____

Number of floors: _____

Total fire area (including garage, if attached): _____ sq. ft.

Number of dwellings served by the driveway*: _____

*If 2 or less, driveway must be at least twelve feet {12'} wide;
if 3 or more, driveway must be at least twenty feet {20'} wide.

Are there any bridges? **Yes** _____ **No** _____

Bridges must be certified by a licensed engineer to a minimum 70,000 lbs. rating.

What is the distance from the street to the furthest point of the structure? _____

Are there any out buildings being built greater than 120 sq. ft? **Yes** _____ **No** _____

I affirm that all information on this form is true and accurate.

Building \$ Value

Applicant's Signature

ACCESS ROAD GUIDELINES (Appendix D attached)

Privately maintained Roadway width, Surface and Turnaround Requirements:

- All access roads serving 1 or 2 dwellings shall have a minimum improved driving surface width of 12 feet.
- All access roads serving 3 or more dwellings shall have a minimum improved driving surface width of 20 feet.
- If the access road exceeds 150 feet in length then a turnaround is required to be placed within 150 feet of the dwellings. (see attached)
- A vertical clearance of 13 feet 6 inches is required over the width of the access road.
- Approved driving surface materials: crushed gravel, recycled asphalt, concrete and asphalt. Surface material minimum thickness of 2 inches placed over 6 inches minimum base of pit run or equivalent.

WATER SUPPLY FOR FIRE SUPPRESSION

Dwellings over 3,600 SF (including attached garages, covered patios and porches) are required to have approved fire suppression water supply. The following are the only approved water supply options:

Municipal Water System – A fire hydrant, supplied by a municipal water system capable of supplying 1500 GPM, located with 1,200 feet driving distance of the residence.

Private and/or Community Well – A fire hydrant, supplied by a private and/or community water system, located within 1,200 feet driving distance of the residence. The hydrant shall be capable of supplying 1500 GPM. For a private and/or community well to be considered as a water supply the owner/applicant will be required to provide fire flow information from the water purveyor that verifies the well is capable of the required fire flow.

Elevated and Pressure Tanks – A fire hydrant, supplied by a tank with a water capacity of 180,000 gallons, located within 1,200 feet driving distance of the residence.

NFPA 13D Fire Sprinkler System – In lieu of the water systems above an NFPA 13D fire sprinkler system may be installed in the residence. Plans for the design of the fire sprinkler system are required to be submitted to the fire jurisdiction for review and approval. Installation inspections of the system will be carried out by the fire jurisdiction.

WILDER RURAL FIRE PROTECTION DISTRICT

208-482-7563 / Fax: 208-482-7890

BUILDING PERMIT/OCCUPANCY PERMIT

This page to be filled out by Fire Official

Name of Applicant: _____

Project Location: _____

Permit fee paid: Amount: \$ _____ Check # _____

Date reviewed: _____

BUILDING PERMIT: APPROVED: _____ DENIED: _____

CONDITIONS OF APPROVAL:

Sprinklers required: Yes: _____ No: _____

Turn-a-round required: Yes: _____ No: _____

Other requirements: _____

Signature of Fire Chief, or designee

Date inspected: _____ CCDSD # _____

Assigned address: _____

OCCUPANCY PERMIT: APPROVED: _____ DENIED: _____

CONDITIONS OF APPROVAL: _____

Additional inspection fee: Amount: _____ Check # _____

Follow up inspection date: _____

Signature of Fire Chief, or designee

Applicant must keep this permit form, and have it available at time of final inspection. If the applicant loses this permit, a new application will need to be completed, and all applicable fees paid. If additional inspections are necessary, there will be an additional fee for each inspection.

Form faxed to CCDSD: Date: _____ By: _____

Water Supply for Fire Suppression

Dwellings over 3,600 SF (including attached garages, covered patios and porches) are required to have approved fire suppression water supply. The following are the only approved water supply options:

Municipal Water System – A fire hydrant, supplied by a municipal water system capable of 1500 GPM, located within 1,200 feet driving distance of the residence.

DRIVEWAY AND PRIVATE ROAD REQUIREMENTS

APPENDIX D

FIRE APPARATUS ACCESS ROADS

The provisions contained in this appendix are not mandatory unless specifically referenced in the adopting ordinance.

SECTION D101 GENERAL

D101.1 Scope. Fire apparatus access roads shall be in accordance with this appendix and all other applicable requirements of the *International Fire Code*.

SECTION D102 REQUIRED ACCESS

D102.1 Access and loading. Facilities, buildings or portions of buildings hereafter constructed shall be accessible to fire department apparatus by way of an approved fire apparatus access road with an asphalt, concrete or other approved driving surface capable of supporting the imposed load of fire apparatus weighing at least 75,000 pounds (34 050 kg).

SECTION D103 MINIMUM SPECIFICATIONS

D103.1 Access road width with a hydrant. Where a fire hydrant is located on a fire apparatus access road, the minimum road width shall be 26 feet (7925 mm). See Figure D103.1.

D103.2 Grade. Fire apparatus access roads shall not exceed 10 percent in grade.

Exception: Grades steeper than 10 percent as approved by the fire chief.

D103.3 Turning radius. The minimum turning radius shall be determined by the fire code official.

D103.4 Dead ends. Dead-end fire apparatus access roads in excess of 150 feet (45 720 mm) shall be provided with width and turnaround provisions in accordance with Table D103.4.


TABLE D103.4
REQUIREMENTS FOR DEAD-END FIRE APPARATUS ACCESS ROADS

LENGTH (feet)	WIDTH (feet)	TURNAROUNDS REQUIRED
0-150	20	None required
151-500	20	120-foot Hammerhead, 60-foot "Y" or 96-foot-diameter cul-de-sac in accordance with Figure D103.1
501-750	26	120-foot Hammerhead, 60-foot "Y" or 96-foot-diameter cul-de-sac in accordance with Figure D103.1
Over 750		Special approval required

For SI: 1 foot = 304.8 mm.

D103.5 Fire apparatus access road gates. Gates securing the fire apparatus access roads shall comply with all of the following criteria:

1. The minimum gate width shall be 20 feet (6096 mm).

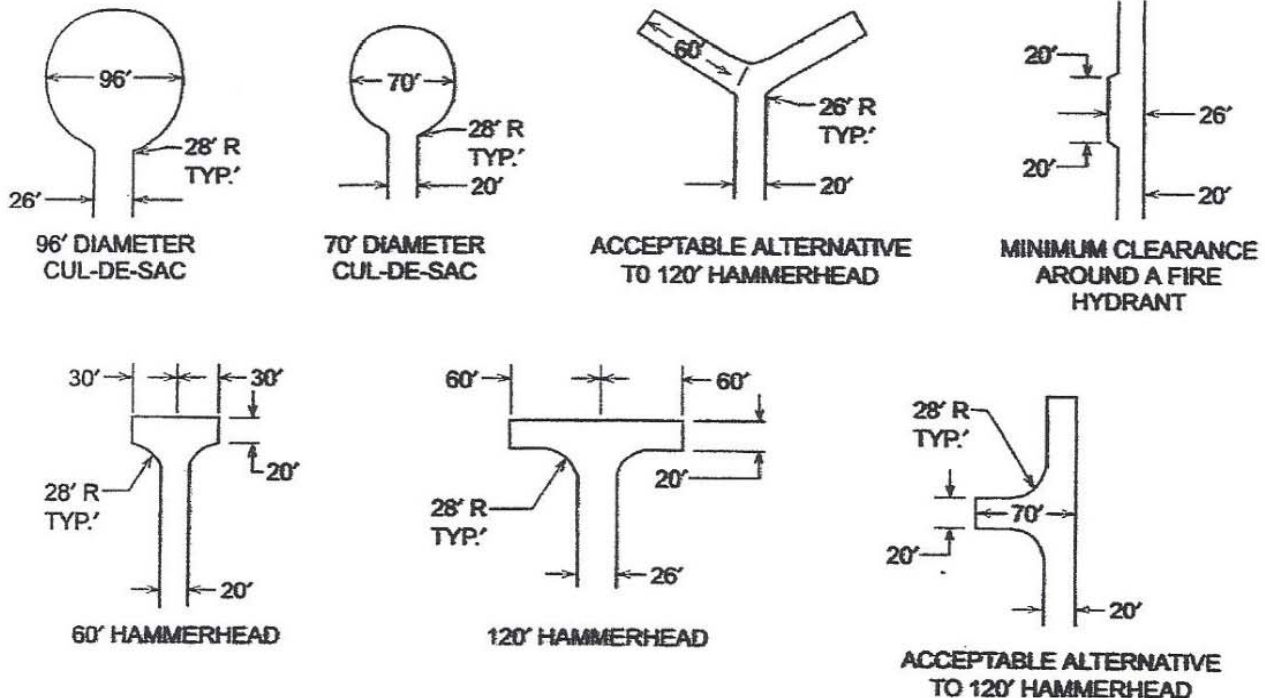

For SI: 1 foot = 304.8 mm.

FIGURE D103.1
DEAD-END FIRE APPARATUS ACCESS ROAD TURNAROUND